



This is a digital copy of a book that was preserved for generations on library shelves before it was carefully scanned by Google as part of a project to make the world's books discoverable online.

It has survived long enough for the copyright to expire and the book to enter the public domain. A public domain book is one that was never subject to copyright or whose legal copyright term has expired. Whether a book is in the public domain may vary country to country. Public domain books are our gateways to the past, representing a wealth of history, culture and knowledge that's often difficult to discover.

Marks, notations and other marginalia present in the original volume will appear in this file - a reminder of this book's long journey from the publisher to a library and finally to you.

### Usage guidelines

Google is proud to partner with libraries to digitize public domain materials and make them widely accessible. Public domain books belong to the public and we are merely their custodians. Nevertheless, this work is expensive, so in order to keep providing this resource, we have taken steps to prevent abuse by commercial parties, including placing technical restrictions on automated querying.

We also ask that you:

- + *Make non-commercial use of the files* We designed Google Book Search for use by individuals, and we request that you use these files for personal, non-commercial purposes.
- + *Refrain from automated querying* Do not send automated queries of any sort to Google's system: If you are conducting research on machine translation, optical character recognition or other areas where access to a large amount of text is helpful, please contact us. We encourage the use of public domain materials for these purposes and may be able to help.
- + *Maintain attribution* The Google "watermark" you see on each file is essential for informing people about this project and helping them find additional materials through Google Book Search. Please do not remove it.
- + *Keep it legal* Whatever your use, remember that you are responsible for ensuring that what you are doing is legal. Do not assume that just because we believe a book is in the public domain for users in the United States, that the work is also in the public domain for users in other countries. Whether a book is still in copyright varies from country to country, and we can't offer guidance on whether any specific use of any specific book is allowed. Please do not assume that a book's appearance in Google Book Search means it can be used in any manner anywhere in the world. Copyright infringement liability can be quite severe.

### About Google Book Search

Google's mission is to organize the world's information and to make it universally accessible and useful. Google Book Search helps readers discover the world's books while helping authors and publishers reach new audiences. You can search through the full text of this book on the web at <http://books.google.com/>

D 101.11:  
5-810-5/990

# **ARMY TM 5-810-5 AIR FORCE AFM 88-8, Chap. 4**

---

## **PLUMBING**

UNIVERSITY OF VIRGINIA  
ALDERMAN LIBRARY

MAY 29 1990

GOVERNMENT DOCUMENTS

UNIVERSITY OF VIRGINIA LIBRARY




X004815059

---

**DEPARTMENTS OF THE ARMY, AND THE AIR FORCE  
12 JANUARY 1990**

Digitized by Google

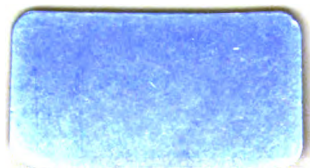

### **REPRODUCTION AUTHORIZATION/RESTRICTIONS**

This manual has been prepared by or for the Government and is public property and not subject to copyright.

Reprints or republications of this manual should include a credit substantially as follows:  
"Joint Departments of the Army and Air Force USA, Technical Manual TM 5-810-5/AFM 88-8, Chap. 4, Plumbing, 16 January 1990."



Technical Manual  
No. 5-810-5  
Air Force Manual  
No. 88-8, Chapter 4

HEADQUARTERS  
DEPARTMENTS OF THE ARMY  
AND THE AIR FORCE  
Washington, DC, 12 January 1990

## PLUMBING

	Paragraph	Page
<b>CHAPTER 1. GENERAL</b>		
Purpose .....	1-1	1-1
Scope .....	1-1	1-1
Basic principles .....	1-3	1-1
Drawings .....	1-4	1-1
Design analysis .....	1-5	1-2
Central systems .....	1-6	1-2
<b>CHAPTER 2. MATERIALS AND FIXTURES</b>		
Fixtures .....	2-1	2-1
Fixture allowances .....	2-2	2-1
Selection of piping and storage tank materials .....	2-3	2-5
Backwater valves and floor drains .....	2-4	2-6
<b>CHAPTER 3. EQUIPMENT</b>		
Pumps and ejectors .....	3-1	3-1
Water pressure booster system .....	3-2	3-1
Tanks .....	3-3	3-1
Interceptors .....	3-4	3-1
Food waste grinders .....	3-5	3-1
Reverse osmosis water treatment equipment .....	3-6	3-2
Water softening treatment equipment .....	3-7	3-2
Central drinking water systems .....	3-8	3-2
<b>CHAPTER 4. WATER SUPPLY AND DISTRIBUTION</b>		
Quality of water .....	4-1	4-1
Protection of water supplies .....	4-2	4-1
Water service .....	4-3	4-1
Service water heating .....	4-4	4-1
<b>CHAPTER 5. WATER PIPING SYSTEMS</b>		
General layout .....	5-1	5-1
Water for plantings .....	5-2	5-1
Standpipes and hose systems for fire protection systems .....	5-3	5-1
Expansion of piping .....	5-4	5-1
Water hammer arresters .....	5-5	5-1
Kitchen and scullery area piping .....	5-6	5-1

\*This manual supersedes TM 5-810-4/AFM 88-8, Chapter 3, dated 1 December 1982.

	Paragraph	Page
CHAPTER 6.	DRAINAGE SYSTEMS	
	Types of systems .....	6-1
	Vents and venting .....	6-2
	Storm drainage .....	6-3

APPENDIX A.	REFERENCES	A-1
		A-2

### LIST OF TABLES

Table 2-1.	Water closet allowances.	2-1
2-2.	Lavatory allowances.	2-2
2-3.	Fixture allowances for UOPH	2-2
2-4.	Fixture allowances for UEPH (minimum number of persons per fixture).	2-3
2-5.	Fixture allowances for facilities. where separate toilet facilities are provided for persons other than employees (minimum number of persons per fixture when more than one fixture is required).	2-3
3-1.	Size of food waste grinders.	3-2
4-1.	Gas heating values.	4-1

## CHAPTER 1 GENERAL

### 1-1. Purpose.

This manual provides guidance in the design of plumbing systems, together with the criteria for selecting plumbing materials, fixtures, and equipment and is applicable to all elements of the Army or Air Force charged with planning military construction.

### 1-2. Scope.

The design of plumbing will comply with the National Standard Plumbing Code, unless otherwise stated. In general, it is not the intent of this manual to duplicate information contained in this and other standards cited herein, but to reference them as appropriate. Appendix A contains a list of references used in this manual. A plumbing system is considered to consist of water supply distribution system; fixtures, and fixture traps; soil, waste, and vent piping; storm water drainage; and acid and industrial waste disposal systems. The system extends from connections within a structure to a point 5 feet outside the structure.

### 1-3. Basic Principles.

In addition to the basic principles outlined in the National Standard Plumbing Code, the following principles will be incorporated into all designs.

a. Siting. Whenever possible, buildings, sewers, and water mains should be sited and designed to avoid the need for sewage lifts or water booster pumps.

b. Piping runs. Piping runs will be arranged to minimize interference with ordinary movement of personnel and equipment. Water and waste piping will not be located in exterior walls or attic spaces where there is danger of freezing.

c. Protection of electrical equipment. Neither water nor drainage piping will be located over electrical wiring or equipment unless adequate protection against water (including condensation) damage has been provided. Insulation alone is not adequate protection against condensation.

### 1-4. Drawings.

The drawings will be accurate and to scale. Graphic symbols will be in accordance with ASME Standard Y32.4. Fixtures, equipment, and piping will be shown in their proper locations. Large-scale details of congested areas will be provided on the drawings, with dimensions locating all work relative to structural features of the building. Each set of drawings will have a legend covering symbols and abbreviations as indicated in ASHRAE Handbook, Fundamentals. Where practical, all notes, legends, and schedules will be grouped at the right of the drawings above the title block. Riser diagrams of soil, waste, drain, and vent stacks and water

risers will be shown for all buildings in excess of one story. The grade of all drain lines will be calculated and invert elevations will be established.

#### a. Equipment notes.

The following notes will be included on the drawings when applicable:

#### (1) Hot water circulating pumps:

- (a) Capacity in gallons per minute.
- (b) Total head in feet.
- (c) Minimum horsepower.
- (d) Volts, phase, hertz.

#### (2) Ejector or sump pump:

- (a) Capacity in gallons per minute.
- (b) Total dynamic head in feet.
- (c) Minimum horsepower.
- (d) Volts, phase, hertz.

#### (3) Water heater:

- (a) Heating capacity in gallons per hour.
- (b) Temperature rise in degrees F.
- (c) Storage capacity in gallons.

#### (4) Hot water storage tank:

- (a) Dimensions.
- (b) Capacity in gallons.

#### (5) Hot water generator:

- (a) Dimensions.
- (b) Storage capacity in gallons.
- (c) Heating surface area.

#### (6) Drinking water dispenser:

- (a) Cafeteria type:
  - Type.
  - Size.
- (b) Electric drinking water cooler:
  - Type.
  - Size.

#### (7) Grease interceptor:

- (a) Fat capacity in pounds.
- (b) Flow rating in gallons per minute.

#### (8) Reverse osmosis water treatment equipment:

- (a) Minimum flow rating in gallons per minute.
- (b) Design and operating temperature in degrees F.

#### (9) Water softening treatment equipment:

- (a) Minimum flow rating in gallons per minute.
- (b) Grains hardness to which water is to be softened.
- (c) Amount of water metered in gallons to start automatic regeneration of a softener unit.

b. Water Service. The following note will be placed on the applicable drawing: "Water pipe sizes are based on a minimum



working pressure of \_\_\_\_\_ psig at a flow rate of \_\_\_\_\_ gpm at the location where the main service enters the building." When water pressure is not known, pressure will be assumed to be the pressure that will not exceed the required minimum residual pressure, plus allowances for pressure due to friction and pressure required for elevation of the highest water outlet.

**1-5. Design analysis.**

The design analysis will include the following:

a. Design basis. Basis for design will consist of:

- (1) Building population (number of males and number of females).
- (2) Plumbing fixture determination, listing quantity and types of fixtures identified by applicable specifications and standards.
- (3) Fixture units for drainage, venting, cold and hot water piping.
- (4) Roof areas used in determining storm drainage pipe sizes.
- (5) Capacities of all equipment and tanks.

b. Calculations. Calculations will be shown clearly so that any changes that become necessary during construction or re-siting may be made efficiently. When tables used in the design are taken from publications, the title, source, and date of the publication will be indicated.

**1-6. Central systems.**

Central systems for medical gas and vacuum will be in accordance with TM 5-838-2 (Army) and AFR 88-50 (Air Force).

## CHAPTER 2 MATERIALS AND FIXTURES

### 2-1. Fixtures.

a. Prohibited fixtures. Fixtures employing continuous-flow devices and fixtures that will backflow are prohibited. Continuous-flow devices cannot be used for water conservation reasons. Drainage fixtures not constructed with impervious materials have proven unsanitary.

b. Water conservation fixtures. Water conservation fixtures conforming to the National Standard Plumbing Code will be used except where the sewer system will not adequately dispose of the waste material on the reduced amount of water.

c. Fixture selection and mounting. Plumbing fixtures will be of the minimum quality required for the type of structure in which fixtures are to be installed, consideration being given to the expected life of the building and to energy conservation. Special care will be required in mounting lavatories and urinals in enlisted men's barracks or dormitories and in men's gang-toilet facilities (three or more water closets). Porcelain-enameled cast-iron lavatories will be provided in enlisted personnel barracks or dormitories or other gang-toilet facilities and will be installed to prevent uplifting.

### 2-2. Fixture Allowances.

a. Employee toilet facilities. Toilet facilities will be provided for employees as follows:

(1) Water closets. Water closets in separate toilet rooms for each sex will be provided in all places of employment according to table 2-1. The number of water closets to be provided for each sex will be based on the number of employees of that sex for whom the toilet facilities are furnished. Separate toilet rooms for each sex need not be provided when toilet rooms will be occupied by no more than one person at a time, can be locked from the inside, and contain at least one water closet. When such single occupancy rooms have more than one water closet, only one such fixture in each toilet room will be counted for the purpose of table 2-1.

Table 2-1. Water closet allowances.

Number of Employees	Minimum Number of Water Closets
1 to 15	1
16 to 35	2
36 to 55	3
56 to 80	4
81 to 110	5
111 to 150	6
151 and over	6 for the first 150, plus 1 additional fixture for each additional 40 employees

<sup>1</sup> Where toilet rooms will not be used by women, urinals may be substituted for some water closets, except that the number of water closets in such cases will not be reduced to less than two-thirds of the minimum specified.

(2) Lavatories. Lavatories will be made available in all places of employment according to table 2-2. In multiple-use lavatory, 24 lineal inches of wash sink or 20 inches of a circular basin, when provided with water outlets for each space, will be considered equivalent to one lavatory. Lavatories in toilet rooms for food service employees will be provided with other than hand-operated valves.

Table 2-2. Lavatory allowances.

Type of Employment <sup>1</sup>	Number of Employees	Minimum Number of Lavatories
Nonindustrial office buildings, public buildings, and similar establishments	1 to 15	1
	16 to 35	2
	36 to 60	3
	61 to 90	4
	91 to 125	5
	126 and over	1 additional fixture for each additional 45 employees

<sup>1</sup> For other types of employment, at least one lavatory for three required water closets will be provided.

(3) Other users. When persons other than employees are permitted the use of toilet facilities on the premises, the number of fixtures will be appropriately increased according to paragraph 2-2b when determining the minimum number required.

(4) Drinking fountains. One drinking fountain for each 75 employees or fraction and at least one fountain per floor will be provided.

b. Unaccompanied personnel housing. Plumbing fixture allowances for unaccompanied officers personnel housing (UOPH) will be according to table 2-3. Plumbing fixture allowances for unaccompanied enlisted personnel housing (UEPH) will be according to table 2-4.

Table 2-3. Plumbing fixture allowances for UOPH.

Occupant	Fixtures
WI to 06	Bathroom for each suite will provide one lavatory, one water closet, and one bathtub with shower. Each floor will include one drinking fountain

Table 2-4. Plumbing fixture allowances for UEPH (minimum number of persons per fixture).

Occupants	Water Closets	Shower <sup>1</sup>	Lavatories	Bathtubs	Urinals Fountains	Drinking
Recruits <sup>2</sup>						
Male	10	8	8	0	15	753
Female	6	8	6	306	None	753
E1 to E4 <sup>5</sup>	4	Note 6	2	47	None	Note 4
E5 to E6 <sup>5</sup>	2	Note 6	1	27	None	Note 4
E7 to E9 <sup>5</sup>	1	Note 6	1	1	None	Note 4

<sup>1</sup> Not less than 3 ft by 3 ft net area.

<sup>2</sup> The figures listed for recruits are also applicable to bathroom facilities for prisoners in confinement facilities.

<sup>3</sup> An additional drinking fountain will be provided in recruit housing for every 30 occupants per floor above the initial 75 occupant requirement.

<sup>4</sup> One drinking fountain per floor will be provided in UEPH projects.

<sup>5</sup> The fixtures listed in this table equal the criteria for the standard 2-person living/sleeping room suite required to be used when constructing new UEPH buildings and will be followed in UEPH modernization projects where providing semiprivate bathroom facilities in living/sleeping room suites for all enlisted personnel is impractical, then private living/sleeping room suites with private bathrooms containing one water closet, one lavatory, and one combination bathtub with shower will be provided for E7 to E9 personnel; and semiprivate living/sleeping room suites served by central bathroom facilities conveniently located to those living/sleeping room suites will be provided for E1 to E6 personnel. E1 to E4 and E5 and E6 personnel will be provided with separate central bathroom facilities when semi-private bathrooms are not possible in UEPH modernization projects. Generally, central bathroom facilities will have a minimum of two water closets and two lavatories, and service not more than 30 persons.

<sup>6</sup> Showers may be substituted for bathtubs at the discretion of the Major Command and installation commander.

<sup>7</sup> Combination bathtubs with shower fixtures will be provided at the rate indicated in the bathtub column. One shower will be substituted for each combination bathtub with shower fixture authorized at the discretion of the Major Command and installation commander.

c. Other occupancies. Plumbing fixture allowances for religious, welfare and recreational facilities for persons other than employees, where separate toilet facilities are provided, will be according to table 2-5.

Table 2-5. Plumbing fixture allowances for facilities where separate toilet facilities are provided for persons other than employees (minimum number of persons per fixture when more than one fixture is required).

Occupancy	Water Closets	Lavatories	Urinals	Drinking Showers	Fountains
Bowling Alley			Joint facilities for employees and patrons will be provided according to tables 2-1 and 2-2.		
Chapel (Congregation only)					
Male	300	150	300	None	400
Female	150	150	None	None	400
Enlisted Personnel Service Club (Patrons only)					
Male	150	150	200	None	500
Female	100	100	None	None	500

General Education  
Development (GED)  
Building  
(Students only)

Male	40	25	25	None	100
Female	25	25	None	None	100

Gymnasium, Field  
House (does not  
include fixtures for  
component swimming  
pools) (Athletic  
participants only-  
spectators according  
to theaters below)

Male	30	30	40	15	100
Female	20	25	None	15	100

Drinking Occupancy	Water Closets	Lavatories	Urinals	Drinking Showers	Fountains
Installation (Post)					
Restaurant or Cafeteria, NCO's Open Mess, Officers' Open Mess (Patrons only)					
Male	200	200	300	None	500
Female	150	150	None	None	500
Library					
Recreational Workshop					
Swimming Pool <sup>1,2</sup> (Swimmers only)					
Male	40	40	40	30	100
Female	20	40	None	30	100
Temporary Lodging					
Theater, Bus and Taxicab Ticket Station, Enlisted Personnel Dining Facilities <sup>3</sup> (Patrons only)					
Male	250	200	250	None	400
Female	150	150	None	None	400

Joint facilities for employees and  
patrons will be provided according  
to tables 2-1 and 2-2.

Provide the following fixtures for each  
two guest rooms: One water closet, two  
lavatories, and one shower compartment  
or bathtub. In addition, a common toilet  
room will be provided for the office  
and lounge.

<sup>1</sup> Fixtures will be provided for swimmers only on this basis: The maximum capacity of the pool (swimmers) will equal the area of the pool (square feet) divided by 27. Where applicable, fixtures for waders will be computed on the basis of not less than 13-1/2 ft<sup>2</sup> per wader instead of 27 ft<sup>2</sup> in depth of less than 5 feet. Separate fixtures will be provided for spectators at indoor swimming pools as indicated opposite "theater" above.

<sup>2</sup> In addition to the above fixtures, "wet toilets" required by wet swimmers and located adjacent to shower rooms will be provided as follows: One "wet toilet" for women, consisting of one water closet for 100 swimmers or less, and two water closets for over 100 swimmers. The "wet toilets" will be so placed that persons using them must pass through the shower before entering the pool.

<sup>3</sup> Patron toilet facilities are not required in enlisted personnel dining facilities that are adjacent to other toilet facilities in existing UEPH buildings. Separate toilet facilities will be provided for kitchen employees according to tables 2-1 and 2-2.

**2-3. Selection of piping and storage tank materials.**

The classification of potable water in c below provides the basis for the selection of piping materials for plumbing systems in permanent buildings. The selection of pipe and fitting materials for acid waste and vent applications will be based upon the type, concentration, and temperature of acid waste to be handled.

a. Pipe and fittings materials. Installation procedure for plastic piping materials will be in accordance with the Plastic Pipe Institute's (PPI), Plastic Piping Manual Design parameters such as thermal, movement, chemical resistance, flow characteristics, and pressure ratings covered in this manual. The designer should be aware that some schedule 40 plastic pipes might have a strength of less than one-tenth that of the strength of a schedule 40 steel pipe; therefore, the desired working pressure ratings for any plastic piping specified must be indicated either in the specifications or on the drawings.

b. Storage tank materials. Storage tanks will be constructed of one of the following combinations of materials and methods:

- (1) Ferrous metals lined with nonferrous metals and provided with cathodic protection.
- (2) Ferrous metals lined with glass and provided with cathodic protection.
- (3) Ferrous metals lined with cement and provided with cathodic protection.
- (4) Fiberglass reinforced plastic for npressure applications.

c. Piping selection. Selection of pipe, valves, and fittings will be in accordance with the quality of the water.

(1) Classification. Water quality is classified under the following categories:

(a) Category 1. Calcium plus magnesium content 0 to 35 parts per million (ppm) expressed as calcium. For this type of water, pipe, valves, and fittings will be nonferrous for both hot- and cold-water service.

b) Category 2. Calcium plus magnesium content 35 to 75 ppm. For this type of water, pipe, valves, and fittings may be ferrous for cold-water service, when sulfates are less than one and one-half times the calcium content. If the sulfate content is more than one and one-half times the calcium content, pipe, valves, and fittings will be nonferrous for cold-water service. All pipe, valves, and fittings for hot-water service will be nonferrous.

(c) Category 3. Calcium plus magnesium content more than 75 ppm. For this type of water, pipe, valves, and fittings may be ferrous for cold-water service and nonferrous for hot-water service if the sulfates are less than twice the calcium content. If the sulfates are more than twice the calcium content, pipe, valves, and fittings will be nonferrous for hot- and cold-water service.

(d) Category 4. Pipe and fittings for salt-water service

will be of thermoplastic and thermosetting plastic. Valves will be plastic or nonferrous metal.

(2) Discussion. In the absence of actual experience at a specific location, the categories shown above, especially category 1, are satisfactory for the selection of potable water piping. Nonferrous piping is recommended for hot-water service regardless of water category and is also recommended for coldwater installations when piping is concealed in walls, partitions, and floors, where replacement would be difficult and expensive, and when the piping is 3 inches in diameter or less. High-chloride content, especially in category 2 and 3 waters, will have a corrosion-causing effect similar to high-sulfate content. If local experience shows that ferrous piping in category 2 and 3 waters has a satisfactory life of 20 to 25 years, ferrous pipe may be used for cold-water service, provided piping is not concealed and replacement can be accomplished economically. Where ferrous and nonferrous materials are joined underground or at water heaters, insulated joints will be installed at those points to break the galvanic couple.

#### 2-4. Backwater valves and floor drains.

a. Backwater valves. In addition to the requirements outlined in the National Standard Plumbing Code, a gate valve will be installed on the sewer side of each backwater valve, and both will be installed in a manhole.

b. Floor drains. Floor drains will be provided in structures having gang toilets and gang shower drying rooms. Gang toilets will be interpreted as those having three or more water closets, and gang shower drying rooms as those serving two or more showers. Trap primers will be installed where traps are subject to drying out in order to insure a proper water seal.

(1) Floor drains will not be provided in walk-in and reach-in refrigerators, except in cold-storage warehouses, as follows:

- (a) Fat-rendering rooms.
- (b) Processing rooms.
- (c) Salvage rooms.
- (d) Receiving rooms.
- (e) Meat coolers.
- (f) Milk, butter, and egg rooms.
- (g) Fruit and vegetable rooms.
- (h) Receiving and issue vestibules.

(2) Floor drains will be provided normally in kitchens at the following locations:

- (a) Dishwashing area.
- (b) Scullery or pot-washing area.
- (c) Steam-jacketed kettle area.
- (d) Vegetable peeler area.
- (e) Vegetable preparation area.
- (f) Adjacent to walk-in and reach-in refrigerators (20 cubic feet or larger).
- (g) Adjacent to icemaking machines.

- (h) Adjacent to garbage refrigerators.
- (i) Washing areas.





## CHAPTER 3 EQUIPMENT

### 3-1. Pumps and ejectors.

Detailed requirements for pumps and ejectors will be in accordance with the standards of the Hydraulic Institute.

a. Sewage pumps. Where sewers are not of sufficient depth to drain the lower floor fixtures by gravity, the main toilet rooms should be located on higher floors. The capacity will be determined by the fixture unit method described in the National Standard Plumbing Code. When the sewage must be pumped, duplex units will be provided below the lowest floor in a concrete pit protected by a safety railing. Duplex sewage pumps will be installed in a separate pump house when the sewage from a group of buildings must be pumped and where it is not possible to install sewage pumps in the buildings. Pump motors will be located so as not to become submerged in back-up sewage caused by electrical service interruption. Packaged pumping systems installed in vertical dry or wet basins with nonclog centrifugal pumps are acceptable, if the influent line leads directly to the discharge line of both pumps and all incoming sewage passes through self-cleaning screens. Auxiliary screens will be installed in influent lines within wet wells, since built-in self-cleaning screens of the pump discharge lines may not be able to handle extreme peak-flow conditions. Combination "T" and check-valve arrangements will be provided in the influent line to each pump to prevent raw sewage from backing into incoming sewer lines, when pumps are operating.

b. Sewage ejectors. Sewage ejectors will be of the duplex pneumatic type and will be located in a concrete pit below the lowest floor. Units will utilize a high-velocity steam, air, or water jet for ejecting the sewage.

c. Sump pumps. Sump pumps will be installed in pits below the lowest floor. Subsoil drains may discharge into this pit. The depth of the pit, below the finished floor, will be in even feet to conform to standard lengths of submerged pump shafts. Pumps with discharge capacities in excess of 25 gallons per minute and with a total head of at least 20 feet will be of the duplex type.

d. Circulating pumps. Criteria determining the need for circulating pumps in ASHRAE Handbook-HVAC Systems and Applications will be followed. Pump sizing will also be in accordance with simplified method in ASHRAE unless specific conditions warrant the need for more detailed calculations.

e. Booster pumps. Booster pumps will be installed when the water pressure to the building is inadequate. Automatic pressure-actuated controls on the suction side of each pump will operate the pump only when necessary to maintain an adequate pressure in the supply piping. A minimum of three pumps will be provided. Minimum capacity for each pump, in gallons per minute, will be based on 50 percent of the total calculated

pump load. The third pump will be a standby unit. Two pumps will alternate operation, except that both pumps will operate when the water in storage drops to a predetermined low level. The third pump will be operated by a manual transfer switch.

### 3-2. Water pressure booster system.

For systems having inadequate water distribution pressure, the following types of systems should be analyzed as to regularity of water flow, allowable water pressure variation, and installed cost.

a. Constant speed pumping system. A constant speed pumping system will not be used where periods of low flow are encountered, since this is a waste of electric energy.

b. Variable speed pumping system. This type of system provides more even pressure than a constant speed system, but is more costly.

### 3-3. Tanks.

Hydro-pneumatic tanks will be provided in buildings to furnish the required volume of water where the pressure on the water supply system is either not adequate to provide the necessary volume or cannot be boosted to a pressure which would provide adequate volume.

### 3-4. Interceptors.

Grease interceptors will be installed underground outside the building. Waste piping from prewash sinks, prewash compartment of dishwashers, pot and pan sinks, or grease-disposing sinks will be connected to interceptors. The areas surrounding interceptors will be paved and provided with suitable drainage facilities. Where design temperatures are less than zero degrees F, interceptors should be located within the building, remote from the kitchen area.

### 3-5. Food waste grinders.

Food waste grinders are authorized in Army and Air Force permanent quarters, hospitals, and dining facilities when the sewage treatment plant can handle the additional load. Design of new sewage treatment plants and additions to existing plants will be based on the increase in load that will result from food waste grinders installed in hospital, dining facilities, and the ultimate projected number of family quarters to be constructed. Food waste grinders installed in hospital kitchens and dining facilities will be sized as shown in table 3-1. Food waste grinders will not discharge into a grease interceptor.

Table 3-1. Size of food waste grinders.

Persons served	Pot washer horsepower	Dishwasher horsepower
Up to 200	2	3
200 to 500	3	5
501 to 1,000	5	7-1/2
Over 1,000	7-1/2	10

### 3-6. Reverse osmosis water treatment equipment.

Reverse osmosis water treatment systems will be installed when water of a higher purity than that produced by the domestic water is required, such as for deionized or distilled water systems used in hospitals. A water quality analysis will be performed and water treatment design will proceed based on that analysis. Reverse osmosis is a general term covering equipment which can have various types of filter elements and membranes and polishing components. The reverse osmosis membrane selection is critical and the operating pressure depends upon the membrane selected. Pump pressures can range from 80 to 800 psi. The reverse osmosis unit is only part of the required treatment systems, which may include pretreatment facilities and organic filters. In some cases, booster pumps may be required for final water distribution. Materials for piping, pumps, valves, and other components must be carefully selected due to the corrosive nature of the high-purity water produced.

### 3-7. Water softening treatment equipment.

Normally, water softening treatment equipment will be installed, when the water analysis performed indicated a total water hardness exceeding 1.0 grains per gallon, (17 ppm) expressed as calcium carbonate. Also, water softening usually is required at laundries, mess halls, and hospitals. Each category has its own recommended limits for maximum hardness. Water hardness for laundries should not exceed 2.5 grains per gallon (43 ppm) and water hardness is usually reduced to zero. Large mess halls should have a water hardness not exceeding that provided for laundries; whereas, hospitals can utilize water of up to 3 grains per gallon (51 ppm) water hardness. Water softening equipment consists of a softener unit and a regeneration brine tank utilizing common salt for regeneration of the softener exchange material. Softening units can be multiple units where two or more units utilize the same regenerating brine tank to provide for continuity of treatment during regeneration of a softening unit.

### 3-8. Central drinking water systems.

Central drinking water systems should be evaluated as an alternative to unitary water coolers in facilities where 15 or more drinking stations are required. Evaluation should include potential heat recovery from central condenser, addition of heat to building envelope by unitary condensers, differences in anticipated energy usage, and differences in first cost.

## CHAPTER 4 WATER SUPPLY AND DISTRIBUTION

### 4-1. Quality of water.

A nonpotable water supply, when used in an entirely separate system and when approved by the local health department, may be used for flushing water closets and urinals, and for other approved purposes where potable water is not required. Piping containing nonpotable water, that is water not meeting accepted potable water standards, will be labeled "NON-POTABLE WATER, DO NOT DRINK."

### 4-2. Protection of water supplies.

Water pumps, hydrants, appliances, and devices will be protected from surface water and outside contamination by approved covers, walls, copings, or casings. Gravity water supply tanks will be covered tightly to keep out foreign materials. Soil or waste lines will not be permitted to pass directly over such tanks. Water pipes, storage tanks, cisterns, and appliances subject to freezing temperatures will be protected. Underground water pipes will be installed below the recognized frost line or will be insulated to prevent freezing. The supply outlet connection to each fixture or appliance that is subject to back-siphonage of nonpotable liquids, solids, or gases will be protected in accordance with the National Standard Plumbing Code. Depending on the severity of the backflow situation, an airgap atmospheric vacuum breaker, double check valve assembly, or reduced-pressure principle device may be required. Air gaps will conform to the National Standard Plumbing Code. Double check valve assemblies, reduced pressure principle assemblies, atmospheric (nonpressure) type vacuum breakers, and pressure type vacuum breakers will be tested, approved, and listed by the Foundation for Cross-Connection Control & Hydraulic Research. Pipe-applied atmospheric type vacuum breakers, hose connection vacuum breakers, and back-flow preventers with intermediate atmospheric vent will be in accordance with American Society of Sanitary Engineering (ASSE) Standards 1001, 1011, and 1012.

**4-3. Water service.** Water service pipes will be sized in accordance with the National Standard Plumbing Code.

Consideration will be given to increasing pipe sizes based on the anticipated future installation of fixtures when performing design calculations.

### 4-4. Service water heating.

Unless otherwise stated in this manual, the design guidance provided for service water heating in ASHRAE Handbook HVAC Systems and Applications will be followed. In addition to criteria provided in ASHRAE for the selection of

heating equipment and storage facilities, consideration should be given to differences in costs of building area required to support systems when calculating life cycle costs.

a. Automatic control. In buildings operated on a nominal 40-hour week or on a nominal two-shift basis (either a 5- or a 7-day week), a clock or other automatic control will be installed on domestic hot-water circulating pumps to permit operation only during periods of occupancy plus 30 minutes before and after.

b. Energy conservation investment program. In older buildings or in unusual cases it may be necessary to do more than reset existing temperature controls in order to save energy. Added storage tanks, temperature blending equipment, or separate lines may be required. Where the aggregate of this work on any one installation meets the minimum requirements for the Energy Conservation Investment Program, (ECIP), consideration should be given to including the work under this program, if the ECIP amortization guidelines can be met.

c. Other considerations.

(1) Gas used for fuel will be considered as having the heating values (expressed in Btu per cubic foot) given in table 4-1.

Table 4-1. Gas heating values.

Type of gas	Btu per cubic foot
Natural gas	1,025
Propane	2,500
Butane	3,393

(2) Because of the high operating cost of electrical equipment, electricity is not used for large-volume water heating when natural gas is available. The fuel equivalent of electricity is 3,415 Btu/kWh.

(3) Solar energy will be evaluated as a means of meeting all or part of the hot-water requirements if required by design instructions. Conventional back-up heating equipment will be provided for periods when high demand or an extended period of cloudy days exceeds the capacity of the solar energy system.

(4) Water treatment. Control of scale formation will be provided with central water treatment on the hot-water system. This system will be in accordance with TM 5-813-3/AFM 88-10, volume 3.

d. Relief valves. In general, each hot water heater, generator, or boiler will be equipped with either separate temperature and pressure relief valves or a combination temperature and pressure relief valve. Hot water storage tanks will be equipped with a pressure relief valve.

## CHAPTER 5 WATER PIPING SYSTEMS

### 5-1. General layout.

In designing water piping layouts, consideration will be given to delivery of water, accessibility of service valves, drains, water piping systems, lawn faucets, and hydrants. Large buildings will be provided with two or more water services to insure constant delivery to all fixtures and equipment. Service lines will enter the building in an accessible location. Provisions for drains will be installed on the fixture side of all service valves located inside a building. The water supply piping will be distributed throughout the building, with mains generally running near the ceiling of the lowest floor. Cross connections between water supply piping and waste, drain, vent, or sewer piping are prohibited. Piping will be designed so that a negative pressure in the water supply pipe and a stopped-up waste, drain, vent, or sewer pipe will not cause backflow of waste water into the water supply piping. Single check valves are not considered adequate protection against back-flow. Water piping will not be located in exterior walls or other spaces where there is danger of freezing.

Commercially available water hammer arresters will be installed where necessary according to manufacturer's recommendations. Vertical capped pipe columns are not permitted.

### 5-6. Kitchen and scullery area piping.

Piping will be concealed wherever possible. Exposed piping attached to or near fixtures or equipment, or subject to high heat or frequent washing, will be copper, brass, or chromium plate. Other exposed piping will be primed with a paint suitable for metal surfaces and finish-painted with color to match background.

### 5-2. Water for plantings.

a. A means of watering lawn areas, flower beds, and gardens will be provided as follows:

- (1) Wall faucets with vacuum breaker backflow preventer on outside walls in nonfreezing climates.
- (2) Wall hydrants with vacuum breaker backflow preventer on outside walls in freezing climates.
- (3) Lawn faucets with vacuum breaker backflow preventer for garden and lawn areas in nonfreezing climates.
- (4) Yard hydrants with vacuum breaker backflow preventer for garden and lawn areas in freezing climates.

b. Wall faucets, wall hydrants, lawn faucets, and yard hydrants will be located so that, with 100 feet of garden hose, the area can be watered without crossing the main entrance of public buildings or barracks. The branch to the lawn faucets and yard hydrants will be equipped with stop and waste valves.

### 5-3. Standpipes and hoses systems for fire protection systems.

Stand-pipes and hose systems will be designed in accordance with NFPA 14.

### 5-4. Expansion of piping.

Expansion of piping will be computed by the method outlined in the ASHRAE Handbook, Equipment. Expansion of plastic piping will be determined from the Plastic Pipe Institute Technical Report PPI-TR21, Thermal Expansion and Contraction of Plastic Pipe.

### 5-5. Water hammer arresters.



## CHAPTER 6 DRAINAGE SYSTEMS

---

### 6-1. Types of systems.

The data covered in this chapter include sanitary drainage, vents and venting, and storm drains. The design work will be in accordance with the National Standard Plumbing Code.

a. Indirect waste. Wastes from stills, tank overflows, relief valve discharges, and equipment used for the sterilization of materials or for storage, preparation, or processing of food or drink must discharge indirectly into the drainage system through an air gap, to an acceptable receptacle. The developed length of an indirect waste will be kept at a minimum with an air gap. Drains from water tanks and discharge from hydraulic elevator sumps will not be connected directly to the drainage system.

b. Arms vault and storage areas. Through-the-wall drains with discharge to grade will be provided in arms vaults and storage areas requiring dehumidification, to dispose of condensate water from dehumifiers. When such drains are not practicable, floor drains will be installed inside the vaults or storage areas to provide for water removal.


### 6-2. Vents and venting.

Design of vent systems will conform to figure 6-1. The seal of every fixture trap in a plumbing system will be protected by an individual vent in accordance with the National Standard Plumbing Code. A branch vent, circuit vent, individual vent, common dual vent, loop vent, relief vent, or stack vent, or a combination of two or more of these vents, is considered adequate protection for trap seals.

### 6-3. Storm drainage.


Storm drainage will include roof drains, leaders, and conductors within the building and to a point 5 feet outside the building. Roof drainage systems will be designed in accordance with rainfall intensity-frequency data in TM 5-820-1/AFM 88-5, chapter 1. Storm drainage outside buildings and building perimeter foundation drainage systems are not covered by this manual.



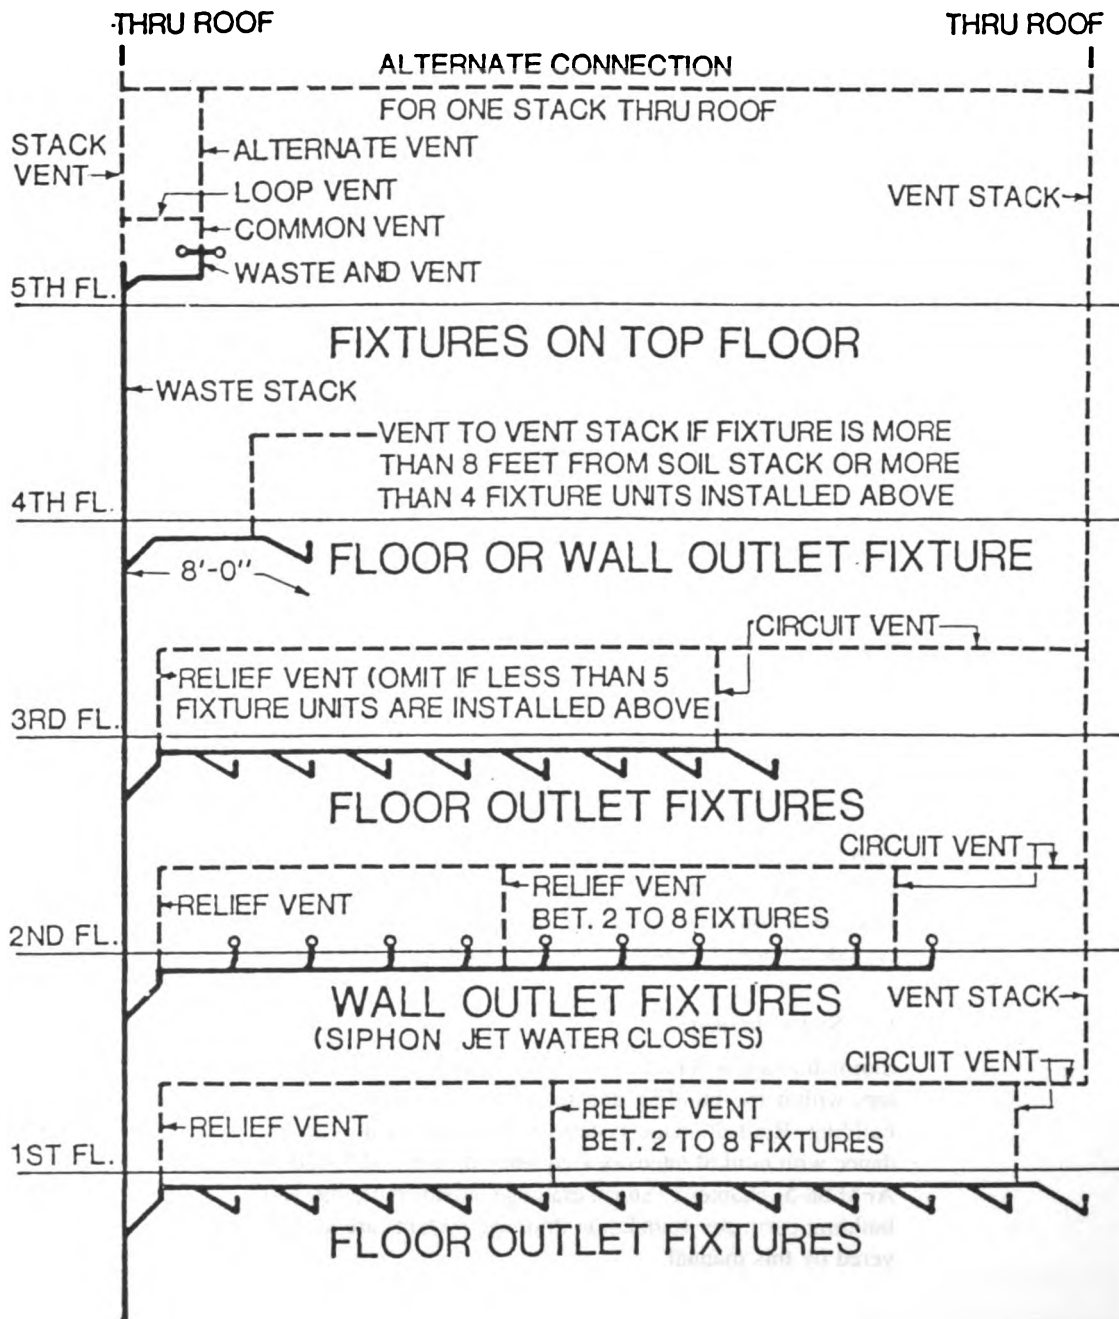


CORPS OF ENGINEERS

Figure 6.1. Soil, waste, and vent diagrams.

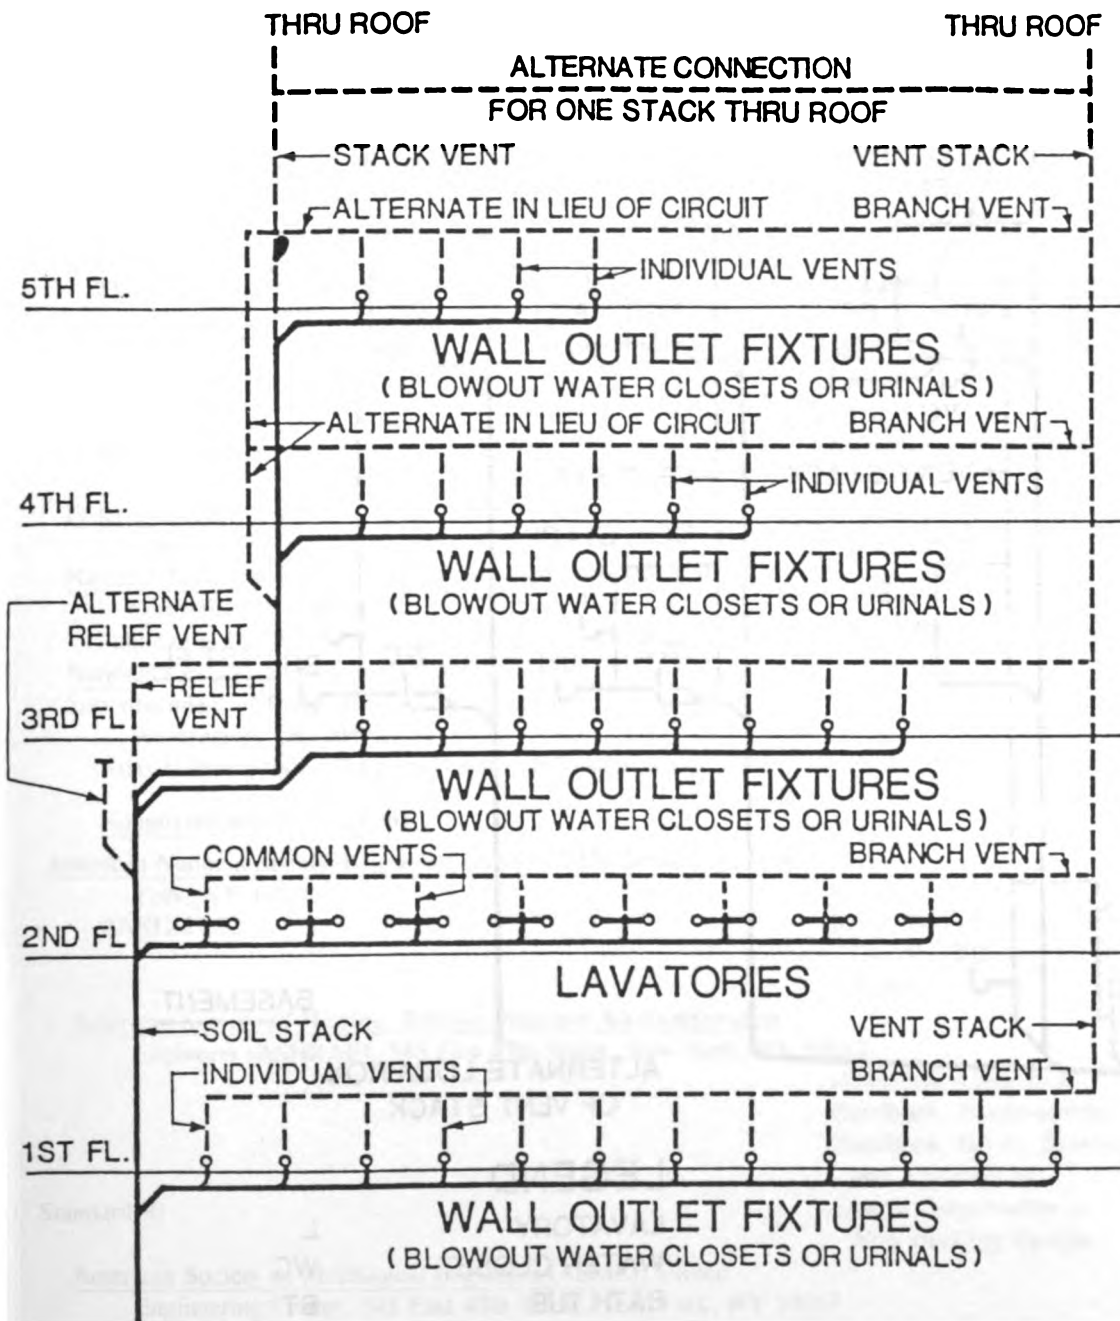

CORPS OF ENGINEERS

Figure 6.1. Soil, waste, and vent diagrams continued.

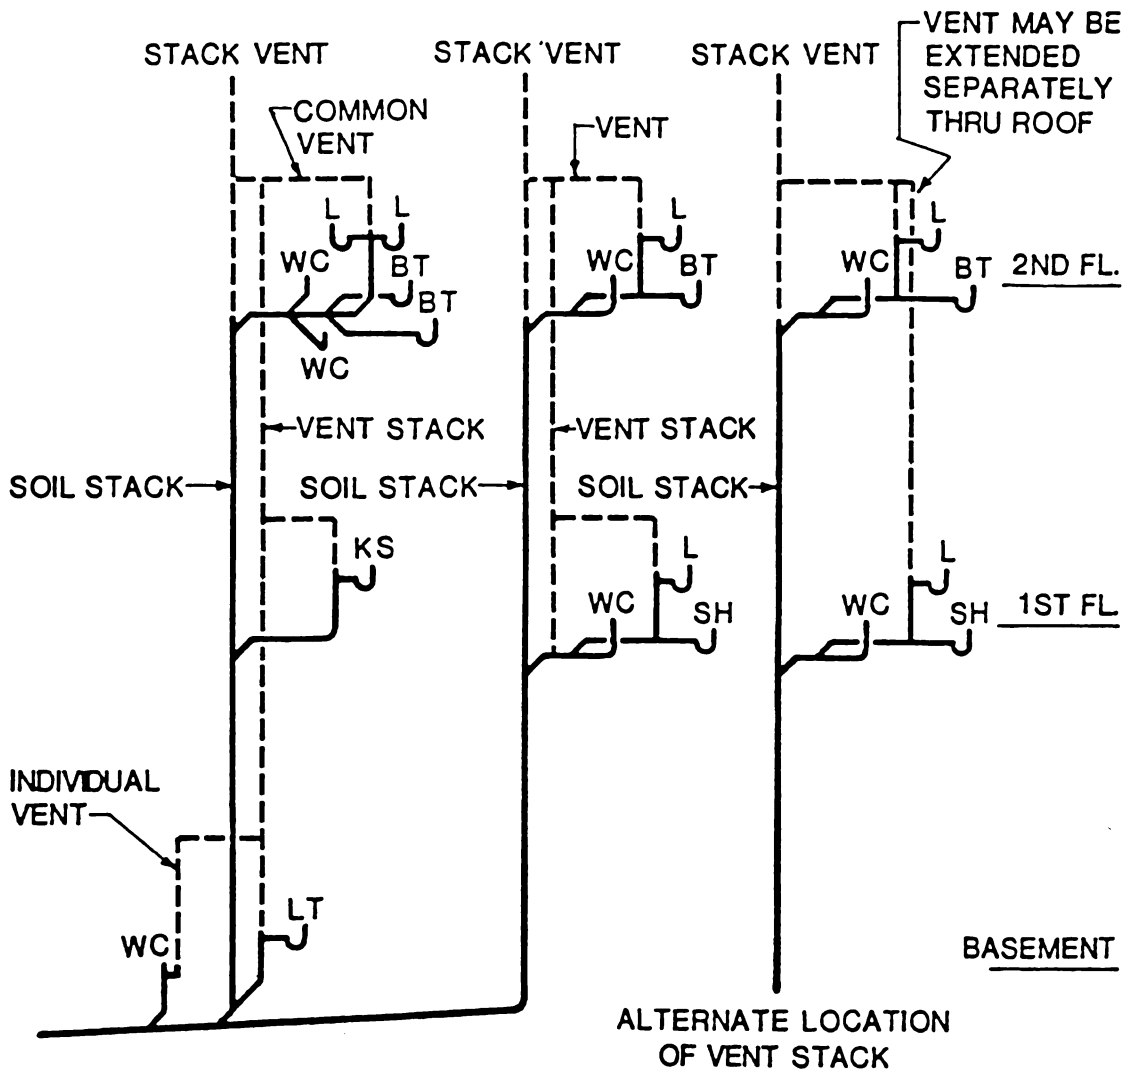

## LEGEND

LAVATORY	L
WATER CLOSET	WC
BATH TUB	BT
KITCHEN SINK	KS
LAUNDRY TRAY	LT
SHOWER	SH

CORPS OF ENGINEERS

Figure 6.1. Soil, waste, and vent diagrams continued.

## APPENDIX A REFERENCES

### Government Publications

#### Departments of the Army and the Air Force

TM 5-813-1/AFM 88-10, vol. 1

TM 5-813-3/AFM 88/10, vol. 3

TM 5-820-1/AFM 88-5, chap. 1

TM 5-838-2

TM 5-842-2

AFR 88-50

#### Federal Specifications

Fed. Spec. WW-P-541

National Technical Information Service, 5285 Port Royal Road,  
Springfield, VA 22161

Publication COM 75-1045 (52 pages) Monograph 31

National Oceanic & Atmospheric Administration (NOAA)

Superintendent of Documents, U.S. Government Printing Office,  
Washington, DC 20402

Atlas II Precipitation Frequency Atlas of Western States

#### Nongovernment Publications

American National Standards Institute (ANSI), 1430 Broadway, New  
York, NY 10018

ANSI Z21.22

American Society of Heating, Refrigerating and Air-Conditioning

Engineers (ASHRAE), 345 East 47th Street, New York, NY 10017

Standard 90

American Society of Mechanical Engineers (ASME), United

Engineering Center, 345 East 47th Street, New York, NY 10017

ASME Y32.4

Section IV

Section VIII

Safety Code CSD-1

CSD-1a-1984

Water Supply General

Considerations

Water Supply Water Treatment

Surface Drainage Facilities

For Airfields and Heliports

Army Health Facility Design

Laundries and Dry Cleaning

Plants

Medical Facilities Design,

Air Force

Plumbing Fixtures

Relief Valves and Automatic

Gas Shutoff Devices for

Supply Systems

Handbook, Equipment

Handbook, Fundamentals

Handbook, HVAC Systems

and Applications

Energy Conservation in

New Building Design

Graphic Symbols for

Plumbing Fixtures for

Diagrams Used in

Architecture and Building

Construction

ASME Boiler and Pressure Vessel Codes.

Heating Boilers

Pressure Vessels, Division I

Controls and Safety Devices

for Automatically fired

Boilers

<u>American Society of Sanitary Engineering (ASSE)</u> , 960 Illuminating Building, Cleveland, OH 44113	
Standard 1001	Pipe Applied Atmospheric Type Vacuum Breakers
Standard 1011	Hose Connection Vacuum Breakers
Standard 1012	Backflow Preventers with Intermediate Atmospheric Veny
<u>National Association of Plumbing-Heating-Cooling Contractors (NAPHCC)</u> , P.O. Box 6808, Falls Church, VA 22046	
NAPHCC-01	National Standard Plumbing Code
<u>National Fire Protection Association (NFPA), Inc.</u> , Batterymarch Park, Qunicy, MA 02269	
NFPA 14-86	Standpipe and Hose Systems
<u>Foundation for Cross-Connection Control and Hydraulic Research (FCCHR)</u> , USC ATTN: BHE315, Los Angeles, CA 90098-0231	
FCCHR-01	Manual of Cross-Connection Control
<u>Hydraulic Institute (HI)</u> , 712 Lakewood Center North 14600 Detroit Avenue, Cleveland, OH 44107	
HI-01	Hydraulic Institute Standards for Central, Rotary and Reciprocating Pumps
<u>Plastic Pipe Institute (PPI)</u> , 355 Lexington Avenue, New York, NY 10017	
PPI-01	Plastics Piping Manual

**The proponent agency of this publication is the Office of Chief of Engineers, United State Army. Army users are invited to send comments and suggest improvements on DA Form 2028 (Recommended Changes to Publications and Blank Forms) directly to HQUSACE, CEMP-ET, WASH DC 20314-1000.**

By Order of the Secretaries of the Army, the Navy, and the Air Force:

CARL E. VUONO  
*General, United State Army*  
*Chief of Staff*

Official:

WILLIAM J. MEEHAN II  
*Brigadier General, United States Army*  
*The Adjutant General*

LARRY D. WELCH, General, USAF  
*Chief of Staff*

Official

WILLIAM O. NATIONS, Colonel, USAF  
*Director Information Management*  
*and Administration*

Distribution:

Army: To be distributed in accordance with DA Form 12-34B, requirements for Plumbing.

Air Force: F



MX 001 716 942



